



CLADDING				
ITEM	PROFILE (min)	FINISH	COLOUR	
ROOF	TRIMDEK 0.42 BMT	СВ	SH	
WALLS	MULTICLAD 0.35 BMT	СВ	SM	
CORNERS	-	СВ	SM	
BARGE	-	СВ	SH	
GUTTER	SHEERLINE	СВ	SH	

0.35bmt=0.40tct; 0.42bmt=0.47tct; 0.48bmt=0.53tct

ACCESSORY SCHEDULE & LEGEND		
QTY	MARK	DESCRIPTION
1	RD1	B&D, Firmadoor, R.D, "R1F-W/Lock", 2300 high x 2750 wide Clear Opening width
1	RD2	B&D, Firmadoor, R.D, "R1F-W/Lock", 2300 high x 2740 wide Clear Opening width
1	KWN1	AMI - Reg A & B, 790x1731 CLR, Window Kit (BDSP)

ARCHITECTURAL DRAWING ONLY, NOT FOR CONSTRUCTION USE

WIND DESIGN			
IMPORTANCE LEVEL	REGION	TERRAIN	Ms
2	Α	2.5	1.0

CLIENT

**Peter Whiting** 

SITE

74 Gladstone Street MUDGEE NSW 2850

BUILDING

SUNDOWN DELUXE 6000 SPAN x 2700 EAVE x 9000 LONG


TITLE


**GENERAL ARRANGEMENT** 

ı	SCALE	DR
	A4 SHEET 1:125	41

DRAWING NUMBER 411997-GA


REV PAGE 1/1





SECTION F-F TYP SECT AT SIDE WALL ROLLER DOOR TYPE A DOORS, OPENING WIDTH PLUS 50mm

TYPE AA & B DOORS, OPENING WIDTH PLUS 100mm

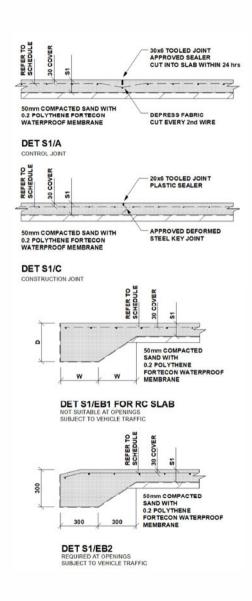



Copyright 2021 Lysaght Building Solutions Pty Ltd trading as RANBUILD

#### NOTES

ALL DIMENSIONS SHOULD BE CHECKED AND VERIFIED PRIOR TO COMMENCEMENT OF ANY WORKS.

IF SLIDING DOORS ARE INCLUDED ON THIS PROJECT, A STRIP FOOTING OR PAD FOOTINGS WILL BE NECESSARY, AND MUST BE POURED IN CONJUNCTION WITH THIS GARAGE'S SLAB OR FOOTINGS.

SEE ERECTION INSTRUCTIONS FOR SECTION & SLAB ADDITIONAL NOTES

SEE ENGINEERING DRAWINGS FOR ADDITIONAL DET'S NOTES & CONCRETE SPECIFICATION

CONTROL JOINTS MUST BE SUPPLIED AT NOT GREATER THAN 4.5m OR CONCRETE POUR AT A RATIO OF NOT MORE THAN 1:1.2 IN ANY DIRECTION

CONSTRUCTION JOINTS MUST BE SUPPLIED WHERE AN UNBROKEN RUN OF CONCRETE POUR EXCEEDS 30m IN ANY DIRECTION

# COLUMN SCHEDULE:

 COLUMN
 SFO
 C

 SGBS15
 60
 154

 $\sim$ 

o

Cont.

## **DIMENSION SCHEDULE:**

<b>D</b> 200	w	S1	X1	X2	Х3	Y1	Y2
200	200	100	160	93	90	40	30

CLIENT

**Peter Whiting** 

SITE

74 Gladstone Street MUDGEE NSW 2850

BUILDING


SUNDOWN DELUXE 6000 SPAN x 2700 EAVE x 9000 LONG

TITLE

**RC SLAB PLAN** 


SCALE NTS	DRAWING NUMBER 411997-RSP	REV <b>A</b>	PAGE <b>1/2</b>	
				l



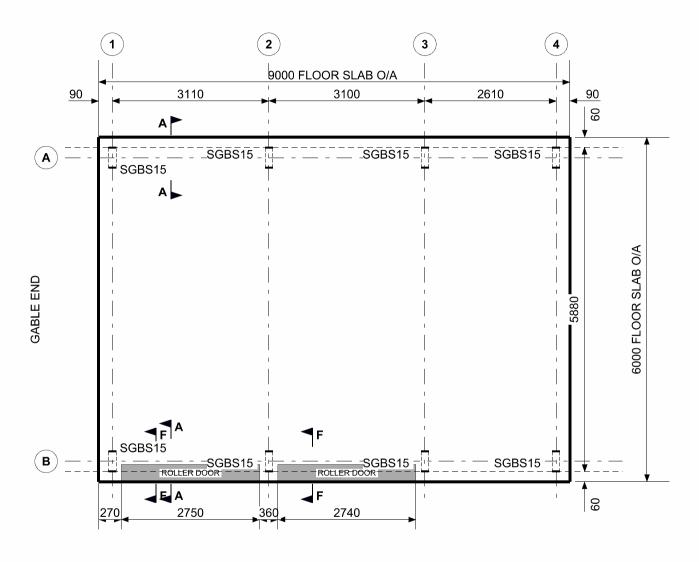

**BASE STRAP & HD BOLT SCHEDULE** 8 REQ'D BASE STRAP SGBS15

SCALE NTS	REV <b>A</b>
DRAWING NUMBER 411997-RSP	PAGE <b>2/2</b>

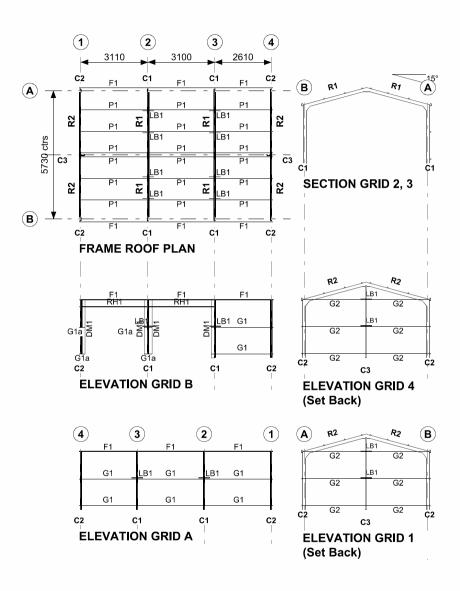



REFERENCE DRAWINGS

STEEL FRAME DIAGRAMS STEEL FRAME SCHEDULE FRAME CONNECTONS ENG1-3595 ENG2-3595 ENG3-3595 RC SLAB ISOLATED PADS ENG4-3595 ENG5-3595 RC SLAB DET'S, CONC. SPEC. & SITE NOTES

CLIENT **Peter Whiting** 

74 Gladstone Street

**MUDGEE NSW 2850** 

BUILDING TYPE Sundown Deluxe

BUILDING DIMENSION 6000S x 2700E x 9000L

STEEL FRAME DIAGRAMS

APPROVED 10-Nov-21

DRAWN REV SCALE DRAWING NUMBER RDS ENG1/1-1998-003595 Α 1:175

STRUC	TURAL STEELWORK SCHE	DULE	CONNE	CTIONS	
MARK	DESCRIPTION	SECTION	BASE	EAVES	ТОР
C1	COLUMN - UNCLAD FRAME	C15010	FB1	KN2	
C2	COLUMN - CLAD FRAME	C15010	FB1	KN2	
C3	COLUMN - END	C15010	EB1		ER1
R1	RAFTER - UNCLAD FRAME	C15010		KN2	AP1
R2	RAFTER - CLAD FRAME	C15010	RA1	KN2	AP1
DM1	MULLION - ROLLER DOOR	C15010	EB1	DM1	MC2
RH1	HEAD - ROLLER DOOR	TS6160 + TS6160	RH1		
LB1	BRACE - LATERAL FLY	95 x 0.6 STRAP	LB1		
	5,004	0.75.50			
F1	FASCIA	0.75 FB			
P1	PURLINS	TS6160 @ 1250	BL1		
G1	GIRTS - SIDE	TS6160 @ 1380	BL1		
G1a		TS6175 @ 1380	BL1		
G2	GIRTS - END	TS6160 @ 1380	BL1		

#### **GENERAL**

- THIS IS A STANDARDISED DESIGN SUITABLE FOR LIGHT INDUSTRIAL COMMERCIAL & RURAL BUILDINGS TO STANDARDS & REQUIREMENTS PROVIDED BY RANBUILD
- . THESE DRAWINGS SHALL BE READ IN CONJUNCTION WITH RANBUILD ASSEMBLY GUIDE
- ANY DISCREPANCY SHALL BE REFERED TO THE ENGINEER BEFORE PROCEEDING WITH WORK.
- ALL MATERIALS & WORKMANSHIP SHALL BE IN ACCORDANCE WITH RELEVANT & CURRENT SAA CODES & WITH BY-LAWS & ORDINANCES OF THE RELEVANT BUILDING AUTHORITIES EXCEPT WHERE VARIED BY THE PROJECT SPECIFICATION
- ALL DIMENSIONS SHOWN SHOULD BE VERIFIED BY THE BUILDER ON SITE.
   FINGINEERS DRAWINGS SHALL NOT BE SCALED FOR DIMENSIONS.
- DURING CONSTRUCTION THE STRUCTURE SHALL BE MAINTAINED IN A STABLE. CONDITION & NO PART SHALL BE OVERSTRESSED. TEMPORARY BRACING SHALL BE PROVIDED BY THE BUILDER TO KEEP THE WORKS & EXCAVATIONS STABLE AT ALL TIMES
- UNLESS NOTED OTHERWISE ALL LEVELS ARE IN METRES & ALL DIMENSIONS ARE IN MILLIMETRES.
- THE STRUCTURAL COMPONENTS DETAILED ON THESE DRAWINGS HAVE BEEN DESIGNED IN ACCORDANCE WITH THE RELEVANT SAA CODES & NORMAL ENGINEERING PRACTICE
- ARCHITECTURAL ELEMENTS TO HAVE A MINIMUM OF 20mm CLEARANCE OF THE STRUCTURE & ARE TO BE ARTICULATED.
- IT IS COMMON SENSE TO WORK SAFELY AND TO PROTECT YOURSELF AND OTHERS FROM ACCIDENTS ON SITE. TO DO THIS, YOU MUST ENSURE YOU HAVE IN PLACE SAFE WORK PRACTICES AND APPROPRIATE EQUIPMENT. SAFETY INVOLVES PERSONAL PROTECTION OF EYES, OF SKIN(FROM SUNBURN) AND OF HEARING(FROM NOISE), FALL PROTECTION MUST ALSO BE IN PLACE AS APPLICABLE INCLUDING SAFÉTY MESH, PERSONAL HARNESSES AND PERIMETER GUARDRAILS. IT IS RECOMMENDED THAT YOU FAMILIARIZE YOURSELF WITH APPLICABLE LAWS REGULATIONS BULES GUIDELINES CODES OF PRACTICE AND STANDARDS AND THAT YOU ADHERE STRICTLY TO

## STRUCTURAL STEEL SPECIFICATION

 ALL STRUCTURAL STEELWORK TO BE CARRIED OUT IN ACCORDANCE WITH THE LATEST EDITIONS OF THE FOLLOWING SAA CODES & SPECIFICATIONS. AS4100 STEEL STRUCTURES CODE

AS/NZS 4600 COLD FORMED STEEL STRUCTURES CODE. AS1511 HIGH STRENGTH STRUCTURAL BOLTING.

AS1111 COMMERCIAL BOLTS & SCREWS. AS2887 FARM STRUCTURES (WHERE APPLICABLE).

 PROPRIETARY PRODUCTS ARE TO BE IN ACCORDANCE WITH THE RESPECTIVE MANUFACTURERS INSTRUCTIONS.

#### FRAME ASSEMBLY

- CORRECT FRAME ASSEMBLY IS IMPORTANT TO ACHIEVE OPTIMUM PERFORMANCE OF THE STRUCTURE
- FULLY TENSION BOLTS AT KNEE & APEX JOINTS AS SPECIFIED BEFORE STANDING
- FULLY TENSION BOLTS AT BASE CONNECTIONS AS SPECIFIED IMMEDIATELY AFTER STANDING THE FRAME
- ROOF & WALL BRACING PROVIDE STRUCTURAL STABILITY WHERE SPECIFIED & MUST. BE INSTALLED BEFORE THE CLADDING.

## SELF DRILLING SCREWS

- QUALITY AND MECHANICAL PROPERTIES OF STRUCTURAL SCREWS MUST COMPLY WITH AS3566 1
- ALL TEK SCREWS SHALL BE NO. 12 14 X 20 U.N.O.
- THE MINIMUM DISTANCE OF EDGE/END SCREWS MUST HAVE AN EDGE DISTANCE OF 1.5 X SCREW DIAMETER FROM THE EDGE.
- THE MINIMUM DISTANCE OF SCREW TO SCREW SPACING MUST NOT BE LESS THAN 3 X SCREW DIAMETER BETWEEN ANY SCREWS.

### HIGH TENSILE BOLTS

- CONNECTIONS WITH 8.8S BOLTS SPECIFIED ARE DESIGNED AS FRICTION TYPE JOINTS & BOLTS, NUTS & WASHERS SHALL COMPLY WITH THE RELEVANT REQUIREMENTS OF AS1252.
- AS1511 & TENSIONED BY AN APPROVED METHOD TO PRODUCE THE FOLLOWING SHANK TENSIONS

BOLT SIZE	SHANK TENSION (
M12	50
M16	90

FOR THIS DESIGN AN ACCEPTABLE TENSIONING METHOD IS SNUG

### CLADDING

- ALL ROOF AND WALL CLADDING TO BE INSTALLED IN ACCORDANCE
- WITH AS1562.1 AND THE MANUFACTURER'S INSTRUCTIONS. ROOF AND WALL CLADDING ARE STRUCTURAL DIAPHRAGM
- BRACINGS. UNDER NO CIRCUMSTANCES SHOULD THE CLADDING BE REMOVED WITHOUT WRITTEN APPROVAL FROM A PRACTICING STRUCTURAL ENGINEER.

#### DESIGN LOADING

• THE STRUCTURAL COMPONENTS SHOWN ON THESE DRAWINGS HAVE BEEN DESIGNED FOR THE FOLLOWING LOAD CONDITIONS COMPLYING WITH AS/NZS 1170 0 1 2 3:-

ROOF DEAD LOAD	SELF WEIGHT ONLY
ROOF LIVE LOAD	(1.8/A+0.12) BUT NOT LESS
	THAN 0.25kPa AND 1.1kN
WIND LOAD REGION	A
TERRAIN CATEGORY	2.5
MPORTANCE LEVEL	2
Ms	1.0
Mt	1.0
NTERNAL PRESSURE	Cpi = -0.3 or 0.0 (ENCLOSED)
COEFFICIENTS	
SITE CLASS	M (CLAY)
GROUND SNOW LOAD Sq	0.5 kPa

 ALL DOORS AND WINDOWS SHALL HAVE THE SAME CYCLONIC WIND LOAD. RATING AS THE REST OF THE BUILDING ENVELOPE. INCLUDING RESISTANCE TO FLYING DEBRIS AS SPECIFIED IN AS1170.2:2011 AND AS/NZS 4505-2012. DOORS AND WINDOWS SHALL BE CLOSED DURING STORMS. DOORS SHALL BE INSTALLED WITH WIND LOCKS IN CYCLONIC AREAS. SUPPORTING DOCUMENTATION INCLUDING TEST REPORTS SHALL BE AVAILABLE FROM DOORS AND WINDOWS MANUFACTURERS TO CONFIRM LOAD RATING AND ENSURE COMPLIANCE WITH ABOVE MENTIONED STANDARDS AND BCA. DOORS ARE ALSO REQUIRED TO BE SUPPLIED WITH A STICKER THAT SHOWS A RANGE OF INFORMATION INCLUDING THE DESIGN PRESSURE OF THE DOOR ACCORDING TO AS/NZS 4505-2012 REQUIREMENTS.

## COPYRIGHT NOTE

• THIS DRAWING REMAINS THE INTELLECTUAL PROPERTY OF RANBUILD, AND MUST NOT BE REPRODUCED, COPIED OR MODIFIED WHOLLY OR IN PART WITHOUT THE WRITTEN PERMISSION OF LYSAGHT BUILDING SOLUTIONS PTY LTD trading as RANBUILD

#### CERTIFICATION

I CERTIFY THAT THE DESIGN OF THIS STEEL FRAMED BUILDING IS STRUCTURALLY ADEQUATE, MEETS SERVICABILITY REQUIREMENTS AND COMPLIES WITH THE RELEVANT REGULATIONS WITH ALL AMENDMENTS CURRENT TO DATE. I FURTHER CERTIFY THE PROPOSED STEEL FRAMED BUILDING WILL BE STRUCTURALLY ADEQUATE WHEN CONSTRUCTED TO GOOD BUILDING PRACTISES, IN ACCORDANCE TO RANBUILD ASSEMBLY GUIDE AND THESE



- ALL BOLTS SHALL BE M16 / 8.8 / S U.N.O
- 8.8/S BOLTS TO BE INSTALLED IN ACCORDANCE WITH

BOLT SIZE	SHANK TENSION (
M12	50
M16	90

TIGHT (PODGER SPANNER TIGHT) PLUS HALF A TURN.




Copyright 2021 Lysaght Building Solutions Pty Ltd trading as RANBUILD REFERENCE DRAWINGS


STEEL FRAME DIAGRAMS ENG1-3595 STEEL FRAME SCHEDULE ENG2-3595 FRAME CONNECTONS ENG3-3595 ENG4-3595 ISOLATED PADS ENG5-3595 RC SLAB DET'S, CONC. SPEC. & SITE NOTES ENG6-3595 CLIENT **Peter Whiting** 


74 Gladstone Street **MUDGEE NSW 2850**  **BUILDING TYPE** Sundown Deluxe BUILDING DIMENSION 6000S x 2700E x 9000L


TITLE STEEL FRAME SCHEDULE AND NOTES


APPROVED 10-Nov-21 DRAWN REV SCALE DRAWING NUMBER RDS ENG2/1-1998-003595

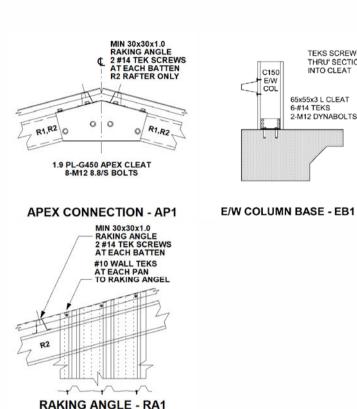










**RAKING ANGLE - RA1** 

SINGLE C150, C200 C250 MULLION

C150, C200, C250 RAD MULLION 2 #14 TEKS TO FASCIA C150, C200, C250 RAD MULLION



**RD MULLION - DM1** 

61mm BATTEN

4 #14 TEK SCREWS TO DOOR MULLION

**RD MULLION CAP - MC2** 

RD HEAD - RH1



**OPENING** THIS SIDE

> Copyright 2021 Lysaght Building Solutions Pty Ltd trading as RANBUILD


REFERENCE DRAWINGS

STEEL FRAME DIAGRAMS ENG1-3595 STEEL FRAME SCHEDULE ENG2-3595 FRAME CONNECTONS ENG3-3595 RC SLAB ENG4-3595 ISOLATED PADS ENG5-3595 RC SLAB DET'S, CONC. SPEC. & SITE NOTES

CLIENT **Peter Whiting** 

74 Gladstone Street **MUDGEE NSW 2850**  BUILDING TYPE **Sundown Deluxe** BUILDING DIMENSION 6000S x 2700E x 9000L TITLE **CONNECTION DETAILS** 

APPROVED 10-Nov-21 DRAWN REV SCALE DRAWING NUMBER RDS Α 1:20 ENG3/1-1998-003595

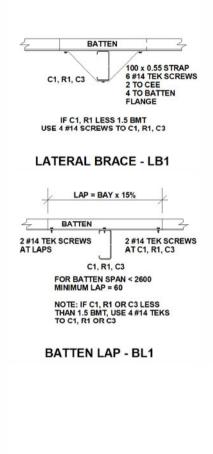

**ROOF CLADDING** SHEAR DIAPHRAGM - RC1

BATTEN

NORMAL 0.35 BMT (MIN), #12-14x45 TEKS

HI PROFILE - CREST FIXED (ALL SUPPORTS)



(ALL SUPPORTS) NORMAL 0.35 BMT (MIN), #10-16x16 TEKS

WALL CLADDING SHEAR DIAPHRAGM - WC3



Copyright 2021 Lysaght Building Solutions Pty Ltd trading as RANBUILD REFERENCE DRAWINGS

STEEL FRAME DIAGRAMS STEEL FRAME SCHEDULE FRAME CONNECTONS RC SLAB ISOLATED PADS ENG5-3595 RC SLAB DET'S, CONC. SPEC. & SITE NOTES

ENG1-3595 ENG2-3595 ENG3-3595 ENG4-3595

74 Gladstone Street **MUDGEE NSW 2850** 

**Peter Whiting** 


CLIENT


BUILDING TYPE Sundown Deluxe

BUILDING DIMENSION

6000S x 2700E x 9000L TITLE **CONNECTION DETAILS**  APPROVED 10-Nov-21

DRAWN REV SCALE DRAWING NUMBER RDS 1:20 ENG3/2-1998-003595 Α





TYP CAST IN STRAP

## RC SLAB

THIS GENERAL PURPOSE RC FLOOR DESIGN IS SUITABLE FOR STRUCTURES USED FOR DOMESTIC. FARM AND COMMERCIAL NON-HABITABLE BUILDINGS SUCH AS GARAGES, STORAGE SHEDS, BARNS, STABLES ETC. THE DESIGN IS NOT SUITABLE FOR STRUCTURES CONVERTED FOR USE AS A DWELLING.

ALL DIMENSIONS SHOULD BE CHECKED AND VERIFIED PRIOR TO COMMENCEMENT OF ANY WORKS.

IF SLIDING DOORS ARE INCLUDED ON THIS PROJECT. A STRIP FOOTING OR PAD FOOTINGS WILL BE NECESSARY, AND MUST BE POURED IN CONJUNCTION WITH THIS GARAGE'S SLAB OR FOOTINGS.

SEE ERECTION INSTRUCTIONS FOR ADDITIONAL NOTES.

## REFERENCE

SEE SLAB DETAIL DRAWING FOR:-

- SITE FOUNDATION CLASSIFICATION NOTES
- MINIMUM SITE PREPARATION NOTES
- CONCRETE SPECIFICATION NOTES
- CONCRETE REINFORCEMENT NOTES

- SLAB ON GRADE NOTES
   DETAIL S1/EB1 SLAB EDGE TYPE 1
   DETAIL S1/EB2 SLAB EDGE TYPE 2
- DETAIL S1/A
   DETAIL S1/C
   DETAIL S1/C
   SLAB CONTROL JOINT
   SLAB CONSTRUCTION JOINT

**RANBUILD** 

Copyright 2021 Lysaght Building Solutions Pty Ltd trading as RANBUILD REFERENCE DRAWINGS

STEEL FRAME DIAGRAMS STEEL FRAME SCHEDULE ENG1-3595 ENG2-3595 FRAME CONNECTONS ENG3-3595 RC SLAB ENG4-3595 ISOLATED PADS ENG5-3595 RC SLAB DET'S, CONC. SPEC. & SITE NOTES

CLIENT **Peter Whiting** 

74 Gladstone Street **MUDGEE NSW 2850**  BUILDING TYPE


Sundown Deluxe

BUILDING DIMENSION 6000S x 2700E x 9000L

**RC SLAB PLAN** 

APPROVED 10-Nov-21

DRAWN REV SCALE DRAWING NUMBER RDS ENG4/1-1998-003595 1:40, 1:175



## ISOLATED PAD FOOTING LEGEND

	"W"x"W"x"D"
PF1	= 400x400x400
PF2	= 350x350x350
PF3	= 400x400x400

## **ISOLATED PAD FOOTINGS**

ISOLATED MASS CONCRETE FOOTINGS ARE ECONOMICALLY SUITED FOR SHEDS ON SANDY GROUND.

- THIS DESIGN MAY ALSO BE USED FOR CLAYEY SOIL OR WHERE ROCK IS ENCOUNTERED.
- ALL PAD FOOTINGS TO BE FOUNDED IN NATURAL GROUND WITH A SAFE BEARING CAPACITY OF 100 kPa AT DEPTH INDICATED.

THE DEPTH "D" MAY BE REDUCED TO A MINIMUM OF 400mm PROVIDED THAT "W" DIMENSIONS ARE ADJUSTED TO MAINTAIN THE SAME VOLUME OF CONCRETE.

CAREFUL PLANNING SHOULD BE MADE WHEN DETERMINING PAD FOOTING SIZES. IF AN ANNEXE OR AWNING IS BEING CONSIDERED AS A FUTURE ADD-ON, INITIAL FOOTING TREATMENT MUST BE MADE. PLEASE CONTACT RANBUILD FOR THIS TREATMENT DETAIL. ALL DIMENSIONS SHOULD BE CHECKED AND VERIFIED PRIOR TO COMMENCEMENT OF ANY WORKS.

THIS DRAWING FOR ISOLATED PAD FOOTINGS IS INSUFFICENT WHEN SLIDING DOORS ARE SPECIFIED, ADDITIONAL STRIP FOOTING UNDER SLIDING DOOR SHALL BE DESIGNED.

SEE ERECTION INSTRUCTIONS FOR ADDITIONAL NOTES.

## REFERENCE

REFER TO THE FOLLOWING NOTES:-

- SITE FOUNDATION CLASSIFICATION NOTES
- MINIMUM SITE PREPARATION NOTES
   CONCRETE SPECIFICATION NOTES
- CONCRETE REINFORCEMENT NOTES



Copyright 2021 Lysaght Building Solutions Pty Ltd trading as RANBUILD REFERENCE DRAWINGS

 STEEL FRAME DIAGRAMS
 ENG1-3595

 STEEL FRAME SCHEDULE
 ENG2-3595

 FRAME CONNECTONS
 ENG3-3595

 RC SLAB
 ENG4-3595

 ISOLATED PADS
 ENG6-3595

 RC SLAB DET'S, CONC. SPEC. & SITE NOTES
 ENG6-3595

CLIENT Peter Whiting

74 Gladstone Street MUDGEE NSW 2850 BUILDING TYPE

Sundown Deluxe
BUILDING DIMENSION
6000S x 2700E x 9000L


TITLE

ISOLATED PAD FOOTING
DETAILS

APPROVED 10-Nov-21

| DRAWN | REV | SCALE | DRAWING NUMBER | RDS | A | 1:40, | ENG5/1-1998-003595

1:175

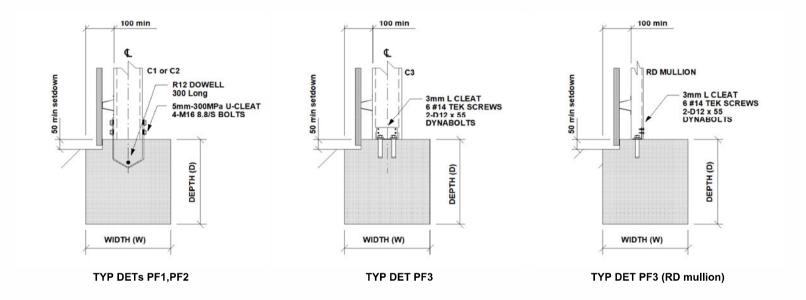



REFERENCE DRAWINGS

ENG1-3595 ENG2-3595 STEEL FRAME DIAGRAMS STEEL FRAME SCHEDULE FRAME CONNECTONS ENG3-3595 RC SLAB ISOLATED PADS ENG5-3595 RC SLAB DET'S, CONC. SPEC. & SITE NOTES

CLIENT **Peter Whiting** 

74 Gladstone Street **MUDGEE NSW 2850**  BUILDING TYPE


Sundown Deluxe BUILDING DIMENSION 6000S x 2700E x 9000L

**ISOLATED PAD FOOTING DETAILS** 

APPROVED 10-Nov-21

DRAWN REV SCALE DRAWING NUMBER RDS 1:40, ENG5/2-1998-003595


1:175



## DET S1/A

CONTROL JOINT


CONTROL JOINTS MUST BE SUPPLIED AT NOT GREATER THAN 4.5M OR CONCRETE POUR AT A RATIO OF NOT MORE THAN 1:1.2 IN ANY



#### DET S1/C


CONSTRUCTION JOINT

CONSTRUCTION JOINTS MUST BE SUPPLIED WHERE AN UNBROKEN RUN OF CONCRETE POUR EXCEEDS 30M IN ANY DIRECTION.



#### **DET S1/EB1 FOR RC SLAB**

SUBJECT TO VEHICLE TRAFFIC



## DET S1/EB2

## SITE FOUNDATION CLASSIFICATION

TWO COMMON FOUNDATION CONDITIONS & SITE CLASSIFICATIONS IN ACCORDANCE WITH AS2870 ARE USED FOR THE STANDARDISED FOOTING DESIGNS AS FOLLOWS:-

- STIFE CLAY CONFORMING TO ASS870 CLASS M. MINIMUM SAFE BEARING CAPACITY - 100 kPa. SHAFT ADHESION - 20 kPa
- DENSE SAND CONFORMING TO AS2870 CLASS A/S. MINIMUM SAFE BEARING CAPACITY - 100 kPa
- A SITE SPECIFIC GEOTECHNICAL INVESTIGATION IS RECOMMENDED & IF CONDITIONS OTHER THAN ASSUMED ARE ENCOUNTERED A DIFFERENT FOOTING DESIGN MAY BE REQUIRED & SHOULD BE REFERED TO A QUALIFIED LOCAL ENGINEER
- ALL FOOTINGS TO BE FOUNDED IN NATURAL GROUND.
- NO FOOTING TO BE FOUNDED ON FILL MATERIAL.
- REFERENCE SHOULD BE MADE TO CSIRO PUBLICATION 10.91 GUIDE TO HOME OWNERS ON FOUNDATION MAINTENANCE & FOOTING PERFORMANCE

#### MINIMUM SITE PREPARATION

- STRIP SITE OF ALL TOP SOIL & DISCARD TO SPOIL. THE EXPOSED SURFACE TO BE PROOF ROLLED & AREAS REMAINING SOFT OR SPONGY ARE TO BE EXCAVATED TO SPOIL.
- PLACE APPROVED GRANULAR FILL MATERIAL TO THE REQUIRED BUILDING PLATFORM LEVEL IN LAYERS NOT EXCEEDING 200mm AND COMPACT BY ROLLING WITH SUITABLE EQUIPMENT TO ACHIEVE A DRY DENSITY RATIO OF 98% STANDARD COMPACTION TO AS1289 - E1 1 AT OPTIMUM MOISTURE CONTENT. THE TOP 200mm TO BE COMPACTED TO 100% STANDARD DRY
- THE COMPACTION OF ALL FILL MATERIAL TO BE INSPECTED AND APPROVED BY A RESPONSIBLE GEOTECHNICAL CONSULTANT.

#### CONCRETE REINFORCEMENT

- REINFORCEMENT IS REPRESENTED DIAGRAMATICALLY & NOT NECESSARILY IN TRUE PROJECTION
- . REINFORCEMENT NOTATION:-
- DENOTES HOT ROLLED DEFORMED BAR.
- DENOTES HARD DRAWN WELDED WIRE FABRIC. THE NUMBER IMMEDIATELY FOLLOWING BAR NOTATION IS THE NOMINAL DIAMETER IN mm.
- PROVIDE BAR SUPPORTS OR SPACERS TO GIVE THE FOLLOWING COVER TO ALL RIENFORCEMENT UNLESS NOTED OTHERWISE.

80 BOTTOM, 65 TOP & SIDES

30 BOTTOM, 20 TOP

BEAMS 40 BOTTOM & SIDES TO STIRRUPS, TOP COVER AS DETAILED

PROVIDE 2N12 DIAGONAL CORNER BARS 900 LONG AT ALL RE-ENTRANT CORNERS OF OPENINGS IN SLABS AND THESE BARS TO BE POSITIONED 30mm FROM THE CORNER

### CONCRETE SPECIFICATION

- CARRY OUT ALL WORK IN ACCORDANCE WITH THE CURRENT ISSUE OF AS3600 & THE SPECIFICATION
- CONCRETE SIZES SHOWN DO NOT INCLUDE FINISH & MUST NOT BE REDUCED OR HOLED IN ANY WAY WITHOUT THE ENGINEERS APPROVAL. DEPTH OF BEAMS INCLUDE SLAB THICKNESS.
- . SLABS & BEAMS ARE TO BE POURED TOGETHER.
- CONSOLIDATE BY VIBRATION
- SLAB CONCRETE TO BE AS SHOWN IN SLAB ON GRADE CRITERIA.
- BORED PIER CONCRETE SHALL HAVE F'c = 20 MPa, MAXIMUM AGGREGATE SIZE = 20 mm. SLUMP = 80 mm EXCEPT FOR BCA CLASSES 2 TO 9 BUILDINGS CONCRETE SHALL HAVE F'c

#### SLABS ON GRADE

- SLABS TO BE PLACED OVER 25 CONSOLIDATED SAND OVER PREPARED SUBGRADE
- PROVIDE 0.2 POLYTHENE FORTICON WATERPROOF MEMBRANE UNDER ALL SLABS WITH LAPPED & TAPED JOINTS
- PLACE PUMP MIX CONCRETE AS SPECIFIED BELOW TO ACCURATE LEVELS AS PER ARCHITECTS SPECIFICATION.
- PROVIDE CONTROL JOINTS AS INDICATED BY NEATLY SAW CUTTING 40 x 6 GROOVES WITHIN 12 HOURS OF THE FINAL FLOAT OF THE CONCRETE.
- CURE SLAB FOR 7 DAYS AFTER PLACEMENT BY MAINTAINING A CONTINUOUSLY WET SURFACE BY APPROVED METHODS. ELOODING & COVERING WITH POLYTHENE IMMEDIATLY AFTER FINISHING IS AN APPROVED METHOD
- SEALING OF JOINTS TO BE CARRIED OUT ONE MONTH MINIMUM AFTER CURING IS COMPLETE.
- PROVIDE PROPER STORMWATER DRAINAGE AWAY FROM THE BUILDING.

SLAB ON GRADE CRITERIA	
CONCRETE COMPRESSIVE STRENGTH AT 28 DAYS (MPa)	20
FLEXURAL STRENGHT AT 90 DAYS (MPa)	5
SLUMP (mm)	80
AGGREGATE MAXIMUM SIZE (MM)	20
CEMENT TYPE	SL
CEMENT CONTENT (kg/cubic metre) MIN	320
FLY ASH CONTENT (kg/cubic metre) MAX	70
WATER / CEMENT RATIO (MAX)	0.45
MICROSTRAIN AT 56 DAYS	600
FLOOR FINISH - BURNISHED STEEL TROWEL	NON SLIP
FLOOR TOLERANCE	CLASS B

• FOR OTHER LOAD CONDITIONS A DESIGN VARIATION IS REQUIRED & SHOULD BE REFERED TO A QUALIFIED LOCAL ENGINEER.

## DIMENSION SCHEDULE

DIMEROION CONEDUCE		
	D	200
	W	200
	S1	100RC SLAB
	FABRIC	SL62T mesh



Copyright 2021 Lysaght Building Solutions Pty Ltd trading as RANBUILD

## REFERENCE DRAWINGS

STEEL FRAME DIAGRAMS ENG1-3595 STEEL FRAME SCHEDULE ENG2-3595 FRAME CONNECTONS ENG3-3595 ENG4-3595 ISOLATED PADS ENG5-3595 RC SLAB DET'S, CONC. SPEC. & SITE NOTES ENG6-3595 CLIENT **Peter Whiting** 

74 Gladstone Street

**MUDGEE NSW 2850** 

**BUILDING TYPE** 

Sundown Deluxe

BUILDING DIMENSION 6000S x 2700E x 9000L

TITLE

RC SLAB DETAILS, CONCRETE SPECIFICATION, SITE NOTES

APPROVED 10-Nov-21

DRAWN REV RDS ENG6/1-1998-003595 1:40