

Noise Assessment

Burrundulla Mini Sustainable Energy Park
Mudgee, NSW.

Prepared for: IT Power (Australia) Pty Ltd
May 2019
MAC180781-04RP1



Document Information

NOISE ASSESSMENT

Burrundulla Mini Sustainable Energy Park

Mudgee, NSW.

Prepared for: IT Power (Australia) Pty Ltd
Southern Cross House
Level 1, 19 Moore Street, Turner ACT
PO Box 6127, O'Connor, ACT, 2602

Prepared by: Muller Acoustic Consulting Pty Ltd
PO Box 262, Newcastle NSW 2300
ABN: 36 602 225 132
P: +61 2 4920 1833
www.mulleracoustic.com

Document ID	Status	Date	Prepared By	Signed	Reviewed By	Signed
MAC180781-04RP1	Final	22 May 2019	[REDACTED]			

DISCLAIMER

All documents produced by Muller Acoustic Consulting Pty Ltd (MAC) are prepared for a particular client's requirements and are based on a specific scope, circumstances and limitations derived between MAC and the client. Information and/or report(s) prepared by MAC may not be suitable for uses other than the original intended objective. No parties other than the client should use or reproduce any information and/or report(s) without obtaining permission from MAC. Any information and/or documents prepared by MAC is not to be reproduced, presented or reviewed except in full.

CONTENTS

1 INTRODUCTION.....5

1.1 PURPOSE AND OBJECTIVES.....5

1.2 SCOPE OF THE ASSESSMENT.....5

2 PROJECT DESCRIPTION.....7

2.1 BACKGROUND.....7

2.2 DESCRIPTION OF PROPOSED CONSTRUCTION WORKS.....7

2.3 DESCRIPTION OF PROPOSED OPERATION.....8

2.4 POTENTIALLY SENSITIVE RECEPTORS.....9

3 NOISE POLICY AND GUIDELINES.....13

3.1 INTERIM CONSTRUCTION NOISE GUIDELINE.....14

3.1.1 CONSTRUCTION NOISE MANAGEMENT LEVELS.....15

3.1.2 CONSTRUCTION SLEEP DISTURBANCE.....16

3.2 NOISE POLICY FOR INDUSTRY.....17

3.2.1 PROJECT NOISE TRIGGER LEVELS.....18

3.2.2 PROJECT INTRUSIVENESS NOISE LEVEL.....18

3.2.3 PROJECT AMENITY NOISE LEVEL.....18

3.2.4 MAXIMUM NOISE LEVEL ASSESSMENT.....20

3.3 ROAD NOISE POLICY.....20

4 ASSESSMENT CRITERIA.....21

4.1 CONSTRUCTION NOISE MANAGEMENT LEVELS.....21

4.2 OPERATIONAL NOISE CRITERIA.....21

4.2.1 PROJECT INTRUSIVENESS NOISE LEVELS.....21

4.2.2 PROJECT AMENITY NOISE LEVELS.....22

4.2.3 PROJECT NOISE TRIGGER LEVELS.....22

4.2.4 MAXIMUM NOISE LEVEL SCREENING CRITERION.....23

4.3 ROAD TRAFFIC NOISE CRITERIA.....23

5 MODELLING METHODOLOGY.....25

5.1	CONSTRUCTION ASSESSMENT METHODOLOGY	25
5.2	OPERATIONAL ASSESSMENT METHODOLOGY	26
5.2.1	OPERATIONAL NOISE MODELLING SCENARIOS	26
5.2.2	METEOROLOGICAL ANALYSIS	27
6	RESULTS	29
6.1	CONSTRUCTION NOISE RESULTS.....	29
6.2	OPERATIONAL NOISE RESULTS	30
6.3	MAXIMUM NOISE LEVEL ASSESSMENT - OPERATIONS	31
6.4	ROAD TRAFFIC NOISE ASSESSMENT.....	31
7	RECOMMENDATIONS	33
7.1	CONSTRUCTION NOISE RECOMMENDATIONS.....	33
7.2	OPERATIONAL NOISE RECOMMENDATIONS	34
8	CONCLUSION	35
APPENDIX A – GLOSSARY OF TERMS		

1 Introduction

Muller Acoustic Consulting Pty Ltd (MAC) has been engaged by IT Power (Australia) Pty Ltd (ITP) to complete a Noise Assessment (NA) for the proposed Burrundulla Mini Sustainable Energy Park (also referred to as Mudgee 1C3C Solar Farm) near Mudgee, NSW (the 'project'). This report presents the methodology and findings of the NA for the construction and operation of the project.

1.1 Purpose and Objectives

A NA is required as part of the Statement of Environmental Effects (SEE) to be submitted to Mid-Western Regional Council as part of the Development Application (DA). The purpose of the NA is to quantify potential environmental noise emissions associated with the construction and operation of the project. Where impacts are identified, the assessment includes recommendations for potential noise mitigation and management measures.

1.2 Scope of the Assessment

The NA includes the following key tasks:

- review construction and operating activities to identify key noise generating plant, equipment, machinery or activities proposed to be undertaken as part of the project;
- identify the closest and/or potentially most affected receivers situated within the area of influence to the project;
- establish existing noise levels to determine project-specific construction Noise Management Levels (NMLs), and operational noise criteria;
- undertake 3D noise modelling to predict levels that may occur as a result of the construction and operation of the project at the closest and/or potentially most affected receivers;
- provide a comparison of predicted noise levels against relevant construction NMLs and operational criteria;
- assess the potential noise impacts associated with construction and operational aspects of the project; and
- provide feasible and reasonable noise mitigation and management measures, and monitoring options, where NMLs or operational criteria may be exceeded.

A glossary of terms, definitions and abbreviations used in this report is provided in **Appendix A**.

This page has been intentionally left blank

2 Project Description

2.1 Background

ITP propose to construct and operate a 10 Megawatt (MW) solar farm using photovoltaic (PV) technology at Lot 6 DP1069441, near Mudgee, NSW. The site is on the Castlereagh Highway approximately 5 km southeast of Mudgee.

2.2 Description of Proposed Construction Works

The project includes installation of groups of north facing PV modules (approximately 2m x 1m) on mounting structures up to approximately 2.5m in height. An estimated 31,416 PV panels will be installed using a single axis tracking system, tilted +/- 60° along the north-south axis. The PV mounting structure would comprise steel posts driven up to approximately 1.6-3.5m below ground using a small pile driver. Additional support structures would be attached to the piles, which would then support the PV panels.

Earthworks will primarily involve trenching which is required for cabling of each PV array/module to inverters and a substation. Other minor earthworks would be completed for the preparation of the site and in most cases a concrete slab would be required to support the ancillary infrastructure. Most of the infrastructure would be pre-fabricated off-site, delivered and assembled on-site.

It is anticipated that the solar farm would be constructed in one-hectare stages, with up to 10 stages in construction at any one time over a six month period during standard construction hours.

All vehicles would access the project via Sydney Road (Castlereagh Highway B55) during construction and operational phases.

During construction, traffic generated by the project would include employee and delivery vehicles. During the peak construction period, the daily traffic volume is expected to be up to four heavy vehicles (semi-trailers or b-doubles) per hour and 20 light commercial vehicles or equivalent mini buses for worker transport during the morning and afternoon peaks.

2.3 Description of Proposed Operation

PV infrastructure on site will comprise of groups of PV panels installed in rows running north to south. Each row of PV modules will rotate to track the sun across the sky from east to west each day. There is approximately 6m spacing between each row. The hub height of each tracker is 1.6m with the peak of the modules reaching a height of 2.5m when the array is fully tilted.

Electrical cabling would be attached beneath the modules and would connect the individual PV modules to each other. Inverters will be located centrally to groups of PV panels and connected to each other by underground cables. The PV modules will be on a single axis tracker system which will follow the sun and move in an east to west direction.

The project will be contained solely within the site as shown in **Figure 1** and **Drawing MUD3C-G-210**.

The project would operate 24 hours a day, 7 days a week, with no permanent staff on site. During operation, the PV panels would generate electricity which would be fed into the power grid via the substation. Key noise emissions from the operation of the project are associated with the inverter and transformer(s). It is noted that emissions from these sources are anticipated to be acoustically insignificant compared to ambient background noise levels at assessed receivers.

When required, maintenance activities will occur during standard working hours (except for emergencies) and are expected to include:

- panel cleaning;
- repairs or replacement of infrastructure, as required; and
- land management including mowing to control vegetation as required.

Typical noise sources associated with maintenance activities would include light vehicle movements on site and maintenance of equipment.

2.4 Potentially Sensitive Receivers

Using aerial photography, geospatial information and other project information, MAC has identified the following potentially sensitive receivers that may be affected by noise from operation or construction activities and project related road traffic. **Table 1** presents a summary of receiver identification address and coordinates. These are reproduced graphically in **Figure 1**.

Table 1 Noise Sensitive Receivers			
ID	Description/Address	Coordinates (MGA 55)	
		Easting	Northing
R1	446 Rocky Waterhole Road	746734	6386721
R2	354 Burrundulla Road	746828	6386871
R3	328 Burrundulla Road	746678	6386886
R4	322 Burrundulla Road	746628	6387068
R5	327 Burrundulla Road	746752	6387106
R6	371 Burrundulla Road	747060	6386824
R7	447 Burrundulla Road	747336	6386590
R8	404 Burrundulla Road	747222	6386502
R9	447 Burrundulla Road	747638	6386439
R10	473 Burrundulla Road	747853	6386198
R11	452 Burrundulla Road	747577	6386062
R12	312 Castlereagh Highway	746180	6385816
R13	344 Castlereagh Highway	746533	6385296
R14	83 Wallinga Lane	746390	6385086
R15	55 Wallinga Lane	746157	6384726
R16	39 Wallinga Lane	745988	6384779
R17	13 Wallinga Lane	745757	6384837
R18	411 Spring Flat Road	745815	6385343
R19	345 Spring Flat Road	745103	6385588
R20	281 Spring Flat Road	744673	6385731
R21	282 Spring Flat Road	744514	6385628
R22	217 Spring Flat Road	744681	6386041
R23 ¹	3B Sydney Road	745146	6386409
R24 ¹	3B Sydney Road	745315	6386582
R25 ¹	3B Sydney Road	745012	6386573
R26 ¹	3B Sydney Road	745897	6386859
R27	252 Burrundulla Road	746152	6387586
R28	275 Burrundulla Road	746398	6387494
R29	243 Castlereagh Highway	746373	6387293
R30	297 Burrundulla Road	746607	6387247

Note 1: Project related receiver.

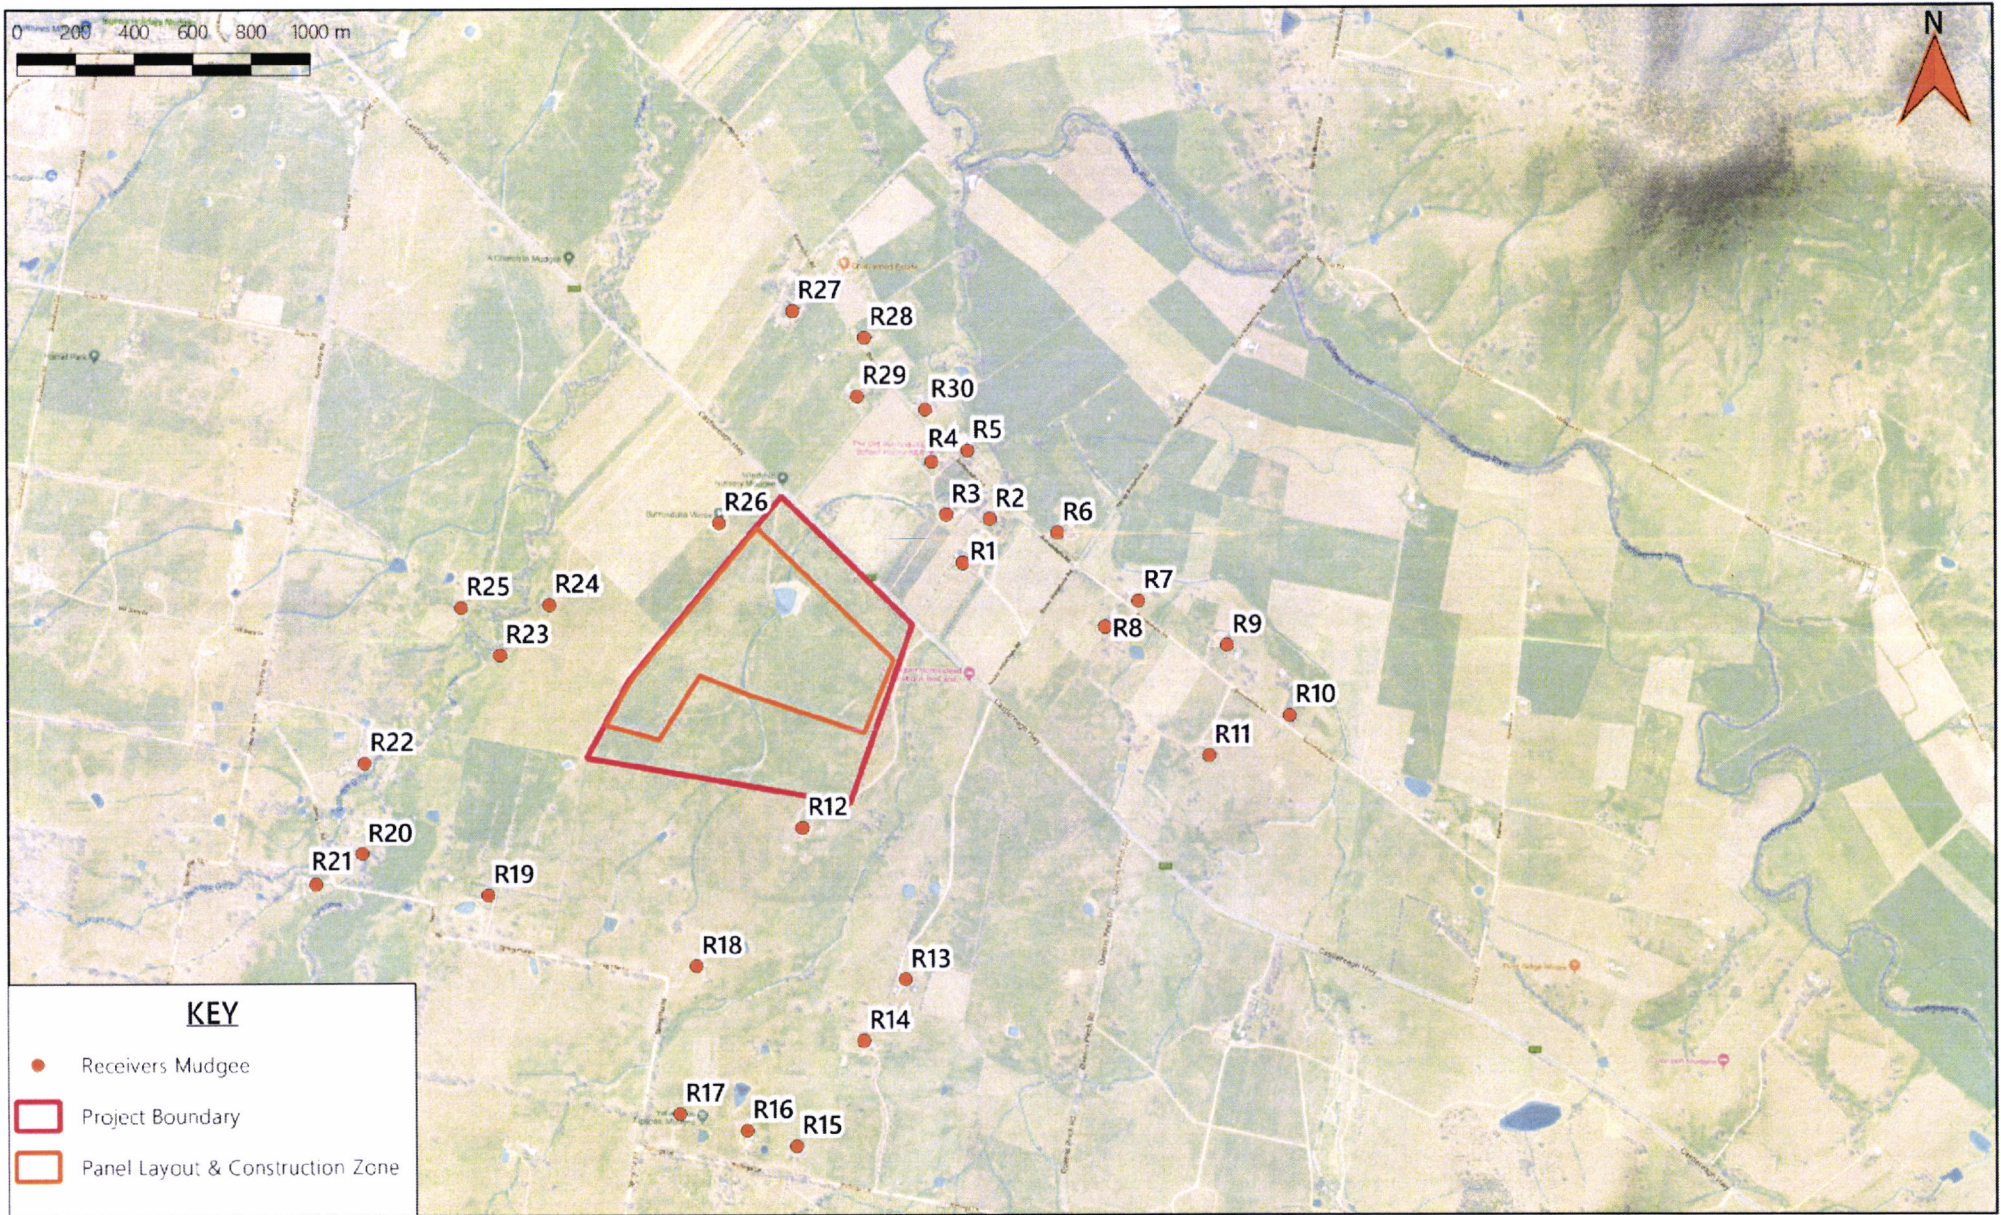


FIGURE 1
PROJECT LAYOUT
REF: MAC180781-04

This page has been intentionally left blank

3 Noise Policy and Guidelines

This Noise Assessment has been conducted in accordance with the following key policy and guidelines:

- NSW Department of Environment and Climate Change, NSW Interim Construction Noise Guideline (ICNG), 2009;
- Environment Protection Authority's (EPA's), Noise Policy for Industry (NPI), 2017; and
- NSW Department of Environment, Climate Change and Water (DECCW), NSW Road Noise Policy (RNP), 2011.

The assessment has also considered and applied the following additional policy, guidelines and standards where relevant:

- Australian Standard AS 2436-2010 (R2016) (AS 2436) – Guide to Noise and Vibration Control on Construction, Demolition and Maintenance sites;
- Australian Standard AS 1055:2018 – Description and Measurement of Environmental Noise;
- Australian Standard AS /NZS IEC 61672.1-2019 (AS 61672) – Electro Acoustics - Sound Level Meters Specifications Monitoring; and
- Australian Standard AS IEC 60942-2004 (AS 60942) – Electroacoustics – Sound Calibrators.

3.1 Interim Construction Noise Guideline

The assessment and management of noise from construction work is completed with reference to the Interim Construction Noise Guideline (ICNG). The ICNG is specifically aimed at managing noise from construction work regulated by the EPA and is used to assist in setting statutory conditions in licences or other regulatory instruments. The types of construction regulated by the EPA under the POEO Act (1997), include construction, maintenance and renewal activities carried out by a public authority, such as road upgrades as described in Schedule 1 of the POEO Act.

The ICNG sets out procedures to identify and address the impact of construction noise on residences and other sensitive land uses. This section provides a summary of noise objectives that are applicable to the assessment.

The ICNG provides two methodologies for the assessment of construction noise emissions:

- Quantitative, which is suited to major construction projects with typical durations of more than three weeks; or
- Qualitative, which is suited to short term infrastructure maintenance (for projects with a typical duration of less than three weeks).

The methodology for a quantitative assessment requires a more complex approach, involving noise emission predictions from construction activities to the nearest relevant receivers. The qualitative assessment methodology is a more simplified approach that relies more on noise management strategies. This study has adopted a quantitative assessment approach.

The quantitative approach includes identification of potentially affected receivers, description of activities involved in the project, derivation of the construction noise management levels, quantification of potential noise impact at receivers and, provides management and mitigation recommendations. **Table 2** summarises the ICNG recommended standard hours for construction.

Table 2 Recommended Standard Hours for Construction	
Period	Preferred Construction Hours
Day (Standard construction hours)	Monday to Friday - 7am to 6pm
	Saturdays - 8am to 1pm
	Sundays or Public Holidays - No construction

The recommended hours do not apply in the event of direction from police, or other relevant authorities, for safety reasons or where required in an emergency to avoid the loss of lives, property and/or to prevent environmental harm. Work conducted outside of standard hours are considered out of hours work (OOH). OOH periods are divided into two categories representing evening and night periods and cover the hours listed below:

Period 1 (evening/low risk period): Monday to Friday – 6pm to 10pm, Saturdays – 1pm to 6pm, Sundays – 8am to 6pm.

Period 2 (night/medium to high risk period): Monday to Friday – 10pm to 7am, Saturdays/Sundays – 6pm to 7am (8am on Sunday mornings).

There are no out of hours work proposed for this project.

3.1.1 Construction Noise Management Levels

Section 4 of the ICNG details the quantitative assessment method involving predicting noise levels and comparing them with the Noise Management Level (NML) and are important indicators of the potential level of construction noise impact. **Table 3** provides the ICNG recommended LAeq(15min) NMLs and how they are to be applied.

Table 3 Noise Management Levels

Time of Day	Management Level L _{Aeq} (15min) ¹	How to Apply
Recommended standard hours: Monday to Friday 7am to 6pm Saturday 8am to 1pm No work on Sundays or public holidays.	Noise affected RBL + 10dB.	The noise affected level represents the point above which there may be some community reaction to noise. Where the predicted or measured L _{Aeq} (15min) is greater than the noise affected level, the proponent should apply all feasible and reasonable work practices to meet the noise affected level. The proponent should also inform all potentially impacted residents of the nature of work to be carried out, the expected noise levels and duration, as well as contact details.
	Highly noise affected 75dBA.	The highly noise affected level represents the point above which there may be strong community reaction to noise. Where noise is above this level, the relevant authority (consent, determining or regulatory) may require respite periods by restricting the hours that the very noisy activities can occur, taking into account times identified by the community when they are less sensitive to noise (such as before and after school for work near schools, or mid-morning or mid-afternoon for work near residences; and if the community is prepared to accept a longer period of construction in exchange for restrictions on construction times.
Outside recommended standard hours.	Noise affected RBL + 5dB.	A strong justification would typically be required for work outside the recommended standard hours. The proponent should apply all feasible and reasonable work practices to meet the noise affected level. Where all feasible and reasonable practices have been applied and noise is more than 5dBA above the noise affected level, the proponent should negotiate with the community.
Commercial	70dBA	Offices, retail outlets
Hospital	45dBA (internal) 55dBA (external)	Assuming 10dB loss through open window

Note 1: The Rating Background Level (RBL) is an overall single figure background level representing each assessment period over the whole monitoring period. The RBL is used to determine the construction noise management levels for noise assessment purposes and is the median of the ABL's.

3.1.2 Construction Sleep Disturbance

Section 4.3 of the ICNG (DECC, 2009) states that a sleep disturbance assessment is required where construction activities are planned to occur for more than two consecutive nights. Given that construction activities are anticipated to occur during standard construction hours, sleep disturbance has not been considered in this assessment.

3.2 Noise Policy for Industry

The EPA released the Noise Policy for Industry (NPI) in October 2017 which provides a process for establishing operational noise criteria for development consents and/or licenses where the EPA regulate noise emissions from scheduled premises under the Protection of the Environment Operations Act 1997. The objectives of the NPI are to:

- provide noise criteria to assess the change in both short term and long term noise levels;
- provide a clear and consistent framework for assessing environmental noise impacts from industrial premises and industrial development proposals;
- promote the use of best-practice noise mitigation measures that are feasible and reasonable where potential impacts have been identified; and
- support a process to guide the determination of achievable noise limits for planning approvals and/or licences, considering the matters under the relevant legislation (such as the economic and social benefits and impacts of industrial development).

The policy sets out a process for industrial noise management during operation, including:

1. Determine the Project Noise Trigger Levels (PNTLs) (ie criteria) for a development. These are the levels, above which noise management measures are required to be considered. They are derived by considering two factors: shorter-term intrusiveness due to changes in the noise environment; and maintaining the noise amenity of an area.
2. Predict or measure the noise levels produced by the development with regard to the presence of annoying noise characteristics and meteorological effects such as temperature inversions and wind.
3. Compare the predicted or measured noise level with the PNTLs, assessing impacts and the need for noise mitigation and management measures.
4. Consider residual noise impacts, where noise levels exceed the PNTLs after the application of feasible and reasonable noise mitigation measures. This may involve balancing economic, social and environmental costs and benefits from the proposed development against the noise impacts, including consultation with the affected community where impacts are expected to be significant.

5. Set statutory compliance levels that reflect the best achievable and agreed noise limits for the development.
6. Monitor and report environmental noise levels from the development.

3.2.1 Project Noise Trigger Levels

The policy sets out the procedure to determine the PNTLs for an industrial development. The PNTL is the lower (ie, the more stringent) value of the **Project Intrusiveness Noise Level** (PINL) and **Project Amenity Noise Level** (PANL) determined in accordance with Section 2.3 and Section 2.4 of the NPI.

3.2.2 Project Intrusiveness Noise Level

The PINL (LAeq(15min)) is the RBL + 5dB and seeks to limit the degree of change a new noise source introduces to an existing environment. When assessing intrusiveness, background noise levels needs to be measured, from which RBLs are determined.

3.2.3 Project Amenity Noise Level

PANL is relevant to a specific land use or locality. To limit continuing increases in intrusiveness levels, the ambient noise level within an area from all combined industrial sources should remain below the recommended amenity noise levels specified in Table 2.2 (of the NPI) and are reproduced in **Table 4**. The NPI defines two categories of amenity noise levels:

- **Amenity Noise Levels (ANL)** – are determined considering all current and future industrial noise within a receiver area.
- **Project Amenity Noise Levels (PANL)** – is the recommended levels for a receiver area, specifically focusing the project being assessed.

Additionally, Section 2.4 of the NPI states: “to ensure that industrial noise levels (existing plus new) remain within the recommended amenity noise levels for an area, a project amenity noise levels applies for each new source of industrial noise as follows”:

- areas with high traffic noise levels;
- proposed developments in major industrial clusters;
- existing industrial noise and cumulative industrial noise effects; and
- greenfield sites.

Notwithstanding, where the PANL is applicable and can be satisfied, the assessment of cumulative industrial noise is not required.

Table 4 Amenity Criteria

Receiver Type	Noise Amenity Area	Time of day	Recommended amenity noise level dB LAeq
Residential	Rural	Day	50
		Evening	45
		Night	40
	Suburban	Day	55
		Evening	45
		Night	40
	Urban	Day	60
		Evening	50
		Night	45
Hotels, motels, caretakers' quarters, holiday accommodation, permanent resident caravan parks	See column 4	See column 4	5dBA above the recommended amenity noise level for a residence for the relevant noise amenity area and time of day
School classroom – internal	All	Noisiest 1-hour period when in use	35
Hospital ward			
- internal	All	Noisiest 1 hour	35
- external		Noisiest 1 hour	50
Place of worship – internal	All	When in use	40
Area specifically reserved for passive recreation (e.g. national park)	All	When in use	50
Active recreation area (e.g. school playground, golf course)	All	When in use	55
Commercial premises	All	When in use	65
Industrial premises	All	When in use	70
Industrial interface (applicable only to residential noise amenity areas)	All	All	Add 5dBA to recommended noise amenity area

Notes: The recommended amenity noise levels refer only to noise from industrial noise sources. However, they refer to noise from all such sources at the receiver location, and not only noise due to a specific project under consideration. The levels represent outdoor levels except where otherwise stated.

Types of receivers are defined as rural residential; suburban residential; urban residential; industrial interface; commercial; industrial – see Table 2.3 and Section 2.7.

Time of day is defined as follows: (These periods may be varied where appropriate, for example, see A3 in Fact Sheet A.)

- day – the period from 7am to 6pm Monday to Saturday or 8am to 6pm on Sundays and public holidays;
- evening – the period from 6pm to 10pm;
- night – the remaining periods.

In the case where existing schools are affected by noise from existing industrial noise sources, the acceptable LAeq noise level may be increased to 40dB LAeq(1hr).

3.2.4 Maximum Noise Level Assessment

The potential for sleep disturbance from maximum noise level events from a project during the night-time period needs to be considered. The NPI considers sleep disturbance to be both awakenings and disturbance to sleep stages.

Where night-time noise levels from a development/premises at a residential location exceed:

- LAeq(15min) 40dBA or the prevailing RBL plus 5dB, whichever is the greater, and/or
- LAmax 52dBA or the prevailing RBL plus 15dB, whichever is the greater,

a detailed maximum noise level event assessment should be undertaken.

A detailed assessment should cover the maximum noise level, the extent to which the maximum noise level exceeds the rating background noise level, and the number of times this happens during the night-time period.

Other factors that may be important in assessing the impacts on sleep disturbance include:

- how often the events would occur;
- the distribution of likely events across the night-time period and the existing ambient maximum events in the absence of the development;
- whether there are times of day when there is a clear change in the noise environment (such as during early morning shoulder periods); and
- current understanding of effects of maximum noise level events at night.

3.3 Road Noise Policy

The road traffic noise criteria are provided in the Department of Environment, Climate Change and Water NSW (DECCW), Road Noise Policy (RNP), 2011. The policy sets out noise criteria applicable to different road classifications for the purpose of quantifying traffic noise impacts. Road noise criteria relevant to this assessment are presented in detail in **Section 6**.

4 Assessment Criteria

Background noise monitoring has not been conducted for this project and hence, the minimum applicable Rating Background Levels (RBL) of 35dBA for the daytime period and 30dBA for the evening and night time periods have been adopted in accordance with NPI methodology.

4.1 Construction Noise Management Levels

Noise Management Levels (NMLs) for construction activities at all residential receivers are 45dB LAeq(15min) (RBL +10dB). Construction activities are planned for standard hours, however the relevant NML standard construction hours and out of hours periods are summarised in **Table 5**.

Table 5 Construction Noise Management Levels			
Location	Assessment Period ¹	RBL, dBA	NML dB LAeq(15min)
All Residential Receivers	Day (Standard Hours)	35	45 (RBL+10dBA)
	Evening (OOH Period 1)	30	35 (RBL+5dBA)
	Night (OOH Period 2)	30	35 (RBL+5dBA)
Commercial	When in Use	N/A	70
Hospital	When in Use	N/A	55

Note 1: See table 2 for Recommended Standard Hours for Construction.

4.2 Operational Noise Criteria

4.2.1 Project Intrusiveness Noise Levels

The PINLs for the project are presented in **Table 6** and have been determined based on the RBLs +5dBA.

Table 6 Project Intrusiveness Noise Levels			
Receiver	Period ¹	Adopted RBL dB LA90	PINL dB LAeq(15min)
All Residential Receivers	Day	35	40
	Evening	30	35
	Night	30	35

Note 1: Day - the period from 7am to 6pm Monday to Saturday or 8am to 6pm on Sundays and public holidays; Evening - the period from 6pm to 10pm; Night - the remaining periods.

4.2.2 Project Amenity Noise Levels

The PANLs for receivers potentially affected by the project are presented in **Table 7**.

Table 7 Project Amenity Noise Levels					
Receiver Type	Noise Amenity Area	Assessment Period ¹	Recommended ANL dB LAeq(period) ²	PANL dB LAeq(period) ³	PANL dB LAeq(15min) ⁴
Residential	Rural	Day	50	50	53
		Evening	45	45	48
		Night	40	40	43
Industrial		When In Use	70	70	73

Note 1: Day - the period from 7am to 6pm Monday to Saturday or 8am to 6pm on Sundays and public holidays; Evening - the period from 6pm to 10pm; Night - the remaining periods.

Note 2: Recommended amenity noise levels as per Table 2.2 of the NPI.

Note 3: Project Amenity Noise Level equals the amenity noise level as there is no other industry in the area.

Note 4: Includes a +3dB adjustment to the amenity period level to convert to a fifteen-minute assessment period as per Section 2.2 of the NPI.

4.2.3 Project Noise Trigger Levels

The PNTLs are the lower of either the PINLs or the PANLs. **Table 8** presents the derivation of the PNTLs in accordance with the methodologies outlined in the NPI. For this assessment the night time PNTL of 35dB LAeq(15min) is the limiting criteria for residential receivers.

Table 8 Project Noise Trigger Levels				
Catchment	Assessment Period ¹	PINL dB LAeq(15min)	PANL dB LAeq(15min)	PNTL dB LAeq(15min)
Residential Receivers (Rural)	Day	40	53	40
	Evening	35	48	35
	Night	35	43	35
Industrial	When In Use	N/A	73	73

Note 1: Day - the period from 7am to 6pm Monday to Saturday or 8am to 6pm on Sundays and public holidays; Evening - the period from 6pm to 10pm; Night - the remaining periods.

4.2.4 Maximum Noise Level Screening Criterion

The maximum noise level screening criterion shown in **Table 9** is based on night time RBLs and trigger values as per Section 2.5 of the NPI.

Table 9 Maximum Noise Assessment Trigger Levels			
Residential Receivers			
L _{Aeq} (15min)		L _{Amax}	
40dB L _{Aeq} (15min) or RBL + 5dB		52dB L _{Amax} or RBL + 15dB	
Trigger	40	Trigger	52
RBL +5dB	35	RBL +15dB	45
Highest	40	Highest	52

Note: As per Section 2.5 of the NPI, the highest of the two criteria are adopted as the screening criteria.

4.3 Road Traffic Noise Criteria

The road traffic noise criteria are provided in the RNP and are presented in **Table 10** for residential receivers.

Table 10 Road Traffic Noise Assessment Criteria for Residential Land Uses				
Road category	Road Name	Type of Project/Development	Assessment Criteria - dBA	
			Day (7am to 10pm)	Night (10pm to 7am)
Freeway/arterial/sub-arterial road	Castlereagh Highway	Existing residences affected by additional traffic on existing freeways/arterial/sub-arterial roads generated by land use developments	60dBA L _{Aeq} (15hr) external	55dBA L _{Aeq} (9hr) external

Note: For road noise assessments, the day period is from 7am to 10pm (ie there is no evening assessment period as there is with operational noise). Night is from 10pm to 7am.

Additionally, the RNP states where existing road traffic noise criteria are already exceeded, any additional increase in total traffic noise level should be limited to 2dB, which is generally accepted as the threshold of perceptibility to a change in noise level.

This page has been intentionally left blank.

5 Modelling Methodology

A computer model was developed to quantify project noise emissions to neighbouring receivers for typical construction activities and operations. DGMR's iNoise (Version 2019) noise modelling software was used to assess potential noise impacts associated with the project. A three-dimensional digital terrain map giving all relevant topographic information was used in the modelling process. Additionally, the model uses relevant noise source data, ground type, shielding such as barriers and/or adjacent buildings and atmospheric information to predict noise levels at the nearest potentially affected receivers. Plant and equipment were modelled at various locations and heights, representative of realistic construction and operational conditions for assessed scenarios.

The model calculation method used to predict noise levels was in accordance with ISO 9613-1 'Acoustics - Attenuation of sound during propagation outdoors. Part 1: Calculation of the absorption of sound by the atmosphere' and ISO 9613-2 'Acoustics - Attenuation of sound during propagation outdoors. Part 2: General method of calculation'.

5.1 Construction Assessment Methodology

Construction activities are proposed to be progressive (trenching, piling and assembly) and will occur at several locations simultaneously. Noise emissions were modelled for the following four scenarios:

- earthworks for internal road and compound construction including the stripping of topsoil and unsuitable soil and the placement and compaction of road base;
- earthworks involving trenching for cabling;
- piling of panel supports; and
- assembly of the panels.

It is envisaged that all four construction scenarios have the potential to occur simultaneously at up to two locations across the site. Noise emission data and assumptions used in this assessment are summarised in **Table 11**. All significant noise generating construction activities will be limited to standard construction hours. Where low intensity construction activities are required to be undertaken outside standard construction hours, such as cabling, minor assembly, use of hand tools etc, they will be managed such that they are not audible at any residential receivers.

Table 11 Construction Equipment Sound Power Levels, Lw dBA re 10⁻¹² W

Noise Source/Item	Utilisation %	Quantity	Lw/Item	Total Lw
Trenching & Earthworks				
Backhoe	80	1	104	103
Light vehicle	25	2	76	73
Total – Trenching & Earthworks				103
Piling				
Piling Rig (hydraulic)	80	1	113	112
Tele-handler	75	1	106	105
Light vehicle	25	2	76	73
Total – Piling				113
Assembly				
Mobile Crane/HIAB	75	1	104	103
Tele-handler	75	1	106	105
Light vehicle	25	2	76	73
Hand tools/Power tools	50	1	102	99
Welder	50	1	105	102
Total – Assembly				109
Transport (on site)				
Heavy vehicle	40	1	104	101
Tele-handler	50	1	106	103
Total – Transport				105

5.2 Operational Assessment Methodology

5.2.1 Operational Noise Modelling Scenarios

For this assessment, noise predictions were modelled for a typical worst-case operational scenario over a 15-minute assessment period based on the assumptions and sound power levels in **Table 12**. Plant noise emission data used in modelling for this assessment were obtained from manufacturers data or the MAC database. Where relevant, modifying factors in accordance with Section 3.3 and Fact Sheet D of the NPI have been applied to calculations.

Table 12 Operational Equipment Sound Power Levels, Lw dBA re 10⁻¹² W

Noise Source/Item	Activity	Quantity	Lw/Item	Total Lw
PV Panel Tracking Motor ^{1,2}	All tracking motors in operation 1 minute per 15-minute period	300-400	78	87
2.5MW Inverter ²	Constant	4	81	97
5MVA Transformer ²	Constant	2	77	90

Note 1: Tracking motor is situated underneath the PV panel, -5dB attenuation applied to account for shielding provided by the panel

Note 2: Modifying factor penalty of +5dB added for low frequency and +5dB added for tonality.

5.2.2 Meteorological Analysis

Noise emissions from industry can be significantly influenced by prevailing weather conditions. Light stable winds (<3m/s) and temperature inversions have the potential to increase noise at a receiver.

Fact Sheet D of the NPI provide two options when considering meteorological effects:

- adopt the noise enhancing conditions for all assessment periods without an assessment of how often the conditions occur, this is conservative approach that considers a source to receiver winds for all receivers and F class temperature inversions with wind speeds up to 2m/s at night; or
- determine the significance of noise enhancing conditions. This requires assessing the significance of temperature inversions (F and G Class stability categories) for the night time period and the significance of light winds up to 3m/s for all assessment periods during stability categories other than E, F or G.

This assessment has adopted default noise enhancing conditions with the meteorological conditions adopted in the noise modelling assessment summarised in **Table 13**.

Table 13 Modelled Site Specific Meteorological Parameters

Assessment Condition ¹	Temperature	Wind Speed / Direction	Relative Humidity	Stability Class
Day - Calm	20°C	3m/s all directions	50%	D
Evening - Calm	10°C	3m/s all directions	50%	D
Night - Calm	10°C	2m/s all directions	50%	F

Note 1: Day 7am to 6pm Monday to Saturday or 8am to 6pm on Sundays and public holidays; Evening 6pm to 10pm; Night - the remaining periods.

This page has been intentionally left blank

6 Results

6.1 Construction Noise Results

Noise levels were predicted to each assessed receptor assuming receiver heights of 1.5m above ground level for typical construction activities during noise enhancing meteorological conditions. **Table 14** summarises the maximum predicted noise level from each of the construction scenarios (trenching, piling and assembly) at identified residential receivers.

Table 14 Predicted Construction Noise Levels

Receiver ID	Description/Address	Predicted	Highest Predicted	NML Standard	Compliance
		Noise Level Range dB LAeq(15min) ¹	Noise Level dB LAeq(15min)	Hours dB LAeq(15min)	
R1	446 Rocky Waterhole Road	43-52	48	45	No ²
R2	354 Burrundulla Road	39-49	46	45	No ²
R3	328 Burrundulla Road	40-51	47	45	No ²
R4	322 Burrundulla Road	37-49	47	45	No ²
R5	327 Burrundulla Road	35-47	45	45	No ²
R6	371 Burrundulla Road	35-46	44	45	No ²
R7	447 Burrundulla Road	32-43	42	45	Yes
R8	404 Burrundulla Road	34-45	43	45	Yes
R9	447 Burrundulla Road	28-40	38	45	Yes
R10	473 Burrundulla Road	22-36	34	45	Yes
R11	452 Burrundulla Road	28-40	39	45	Yes
R12	312 Castlereagh Highway	30-57	51	45	No ²
R13	344 Castlereagh Highway	27-45	43	45	Yes
R14	83 Wallinga Lane	22-42	41	45	Yes
R15	55 Wallinga Lane	19-38	37	45	Yes
R16	39 Wallinga Lane	19-39	38	45	Yes
R17	13 Wallinga Lane	19-37	36	45	Yes
R18	411 Spring Flat Road	23-44	43	45	Yes
R19	345 Spring Flat Road	20-43	40	45	Yes
R20	281 Spring Flat Road	18-40	37	45	Yes
R21	282 Spring Flat Road	16-36	35	45	Yes
R22	217 Spring Flat Road	18-41	41	45	Yes
R23	3B Sydney Road	23-48	48	45	Yes ^{2,3}
R24	3B Sydney Road	24-49	50	45	Yes ^{2,3}
R25	3B Sydney Road	21-45	45	45	Yes ^{2,3}
R26	3B Sydney Road	31-56	57	45	Yes ^{2,3}

Table 14 Predicted Construction Noise Levels

Receiver ID	Description/Address	Predicted	Highest Predicted	NML Standard	Compliance
		Noise Level Range dB LAeq(15min) ¹	Noise Level dB LAeq(15min)	Hours dB LAeq(15min)	
R27	252 Burrundulla Road	28-44	43	45	Yes
R28	275 Burrundulla Road	30-45	43	45	Yes
R29	243 Castlereagh Highway	33-48	46	45	No ²
R30	297 Burrundulla Road	34-47	45	45	No ²

Note 1: Noise levels from construction activities vary due to their location across the project site

Note 2: Noise levels exceed NMLs when construction activities are at their nearest point to receivers.

Note 3: Project related receiver.

Noise levels at six receivers are expected to exceed the NMLs when works are nearest to those locations. The exceedance would be temporary, and of short duration and is primarily due to piling and trenching activities, particularly at R12. However, it is likely that the effect of construction noise at receivers R1 to R4 and R29 will be reduced or possibly inaudible due to the masking noise from the Castlereagh Highway.

6.2 Operational Noise Results

Noise levels were predicted at each assessed receptor assuming receiver heights of 1.5m above ground level during worst case noise enhancing meteorological conditions. **Table 15** summarises the predicted operational noise levels which are demonstrated to comply with the PNTLs at all residential receivers.

Table 15 Predicted Operational Noise Levels

Receiver ID	Address	Predicted Noise Level	Limiting Night PNTL	Compliance
		dB LAeq(15min)	dB LAeq(15min)	
R1	446 Rocky Waterhole Road	20	35	Yes
R2	354 Burrundulla Road	<20	35	Yes
R3	328 Burrundulla Road	<20	35	Yes
R4	322 Burrundulla Road	<20	35	Yes
R5	327 Burrundulla Road	<20	35	Yes
R6	371 Burrundulla Road	<20	35	Yes
R7	447 Burrundulla Road	<20	35	Yes
R8	404 Burrundulla Road	<20	35	Yes
R9	447 Burrundulla Road	<20	35	Yes
R10	473 Burrundulla Road	<20	35	Yes
R11	452 Burrundulla Road	<20	35	Yes
R12	312 Castlereagh Highway	23	35	Yes
R13	344 Castlereagh Highway	<20	35	Yes

Table 15 Predicted Operational Noise Levels

Receiver ID	Address	Predicted Noise Level dB LAeq(15min)	Limiting Night PNTL dB LAeq(15min)	Compliance
R14	83 Wallinga Lane	<20	35	Yes
R15	55 Wallinga Lane	<20	35	Yes
R16	39 Wallinga Lane	<20	35	Yes
R17	13 Wallinga Lane	<20	35	Yes
R18	411 Spring Flat Road	<20	35	Yes
R19	345 Spring Flat Road	<20	35	Yes
R20	281 Spring Flat Road	<20	35	Yes
R21	282 Spring Flat Road	<20	35	Yes
R22	217 Spring Flat Road	<20	35	Yes
R23	3B Sydney Road	<20	35	Yes
R24	3B Sydney Road	<20	35	Yes
R25	3B Sydney Road	<20	35	Yes
R26	3B Sydney Road	23	35	Yes
R27	252 Burrundulla Road	<20	35	Yes
R28	275 Burrundulla Road	<20	35	Yes
R29	243 Castlereagh Highway	<20	35	Yes
R30	297 Burrundulla Road	<20	35	Yes

6.3 Maximum Noise Level Assessment - Operations

A detailed maximum noise level assessment is not required as predicted noise levels for night time operations do not exceed the maximum noise level screening criterion of 40dB LAeq(15min) and/or 52dB LMax.

6.4 Road Traffic Noise Assessment

The route via Castlereagh Highway would be the major transport route for all vehicles to the project site. During construction, traffic generated by the project include employee/subcontractor and delivery vehicles. The traffic volume over a typical day for standard construction hours is expected to be up to four heavy vehicles (semi-trailers or B-doubles) per hour and 20 light commercial vehicles or equivalent mini buses for worker transport during the morning and afternoon peak hour periods.

Predicted LAeq(1hr) noise levels from project related construction traffic at the closest receiver (80m from the road) situated along Sydney Road (Castlereagh Highway B55) to the site access has been completed using the United States (US) Environment Protection Agency's road traffic calculation method is presented in **Table 16**.

Table 16 Predicted Construction Road Traffic Noise Levels				
Road Name	Nearest Offset Distance to Receiver	Predicted Noise Level	RTN Criteria	Comply
Sydney Road (B55)	80m	<40dB LAeq(15hr)	60dB LAeq(15hr)	Yes

Results demonstrate that project construction traffic noise levels would comply with the relevant RNP criteria.

7 Recommendations

7.1 Construction Noise Recommendations

It is noted that construction noise emissions are expected to exceed the relevant NMLs depending on proximity of activities to receivers. Recommendations for consideration during construction activities to reduce emissions to the surrounding community for this project may include:

- a construction noise management protocol to minimise noise emissions, manage out of hours (minor) works to be inaudible, and to respond to potential concerns from the community;
- where possible use localised mobile screens or construction hoarding around plant to act as barriers between construction works and receivers, particularly where equipment is near the site boundary and/or a residential receiver including areas in constant or regular use (eg unloading and laydown areas);
- operating plant in a conservative manner (no over-revving), shutdown when not in use, and be parked/started at farthest point from relevant assessment locations;
- selection of the quietest suitable machinery available for each activity;
- avoidance of noisy plant/machinery working simultaneously where practicable;
- minimise impact noise wherever possible;
- utilise a broadband reverse alarm in lieu of the traditional high frequency type reverse alarm;
- provide toolbox meetings, training and education to drivers and contractors visiting the site during construction so they are aware of the location of noise sensitive receivers and to be cognisant of any noise generating activities;
- signage is to be placed at the front entrance advising truck drivers of their requirement to minimise noise both on and off-site; and
- utilise project related community consultation forums to notify residences within close proximity of the site with project progress, proposed/upcoming potentially noise generating works, its duration and nature and complaint procedure.

7.2 Operational Noise Recommendations

Operational noise predictions identify that relevant noise criteria would be satisfied at all receivers. Notwithstanding, it is recommended that the proponent actively minimise potential noise emissions from the project. To assist in noise management for the project it is recommended that a one-off noise validation monitoring assessment be completed to quantify emissions from site and to confirm emissions meet relevant criteria.

8 Conclusion

Muller Acoustic Consulting Pty Ltd (MAC) has been engaged by IT Power (Australia) Pty Ltd (ITP) to complete a Noise Assessment (NA) for the proposed Burrundulla Mini Sustainable Energy Park near Mudgee, NSW. The assessment has quantified potential noise emissions associated with the construction and operation of the project.

The results of the NA demonstrate that construction noise levels have potential to exceed relevant construction NMLs at six receiver locations. However the effect is likely to be over estimated at five of those receivers as masking noise from the Castlereagh Highway has not been assessed and the effect at the remaining location would be when activities are in close proximity to the receiver. Recommendations have been provided to minimise the potential noise impacts from construction, albeit of a temporary nature during the daytime over a three month construction period.

Operational noise levels satisfy the NPI PNTLs for assessed receivers. However, recommendations to ensure noise levels are verified have been provided in this report.

Additionally, the NA demonstrates that the road noise criteria as specified in the RNP will be satisfied at all receivers on the proposed transport route.

Based on the NA results, there are no noise related issues which would prevent the approval of the project. The results of the assessment shows compliance with the relevant operational and road noise criteria. Accordingly, no additional ameliorative measures will be required.

This page has been intentionally left blank

Appendix A – Glossary of Terms

A number of technical terms have been used in this report and are explained in Table A1.


Table A1 Glossary of Terms	
Term	Description
1/3 Octave	Single octave bands divided into three parts
Octave	A division of the frequency range into bands, the upper frequency limit of each band being twice the lower frequency limit.
ABL	Assessment Background Level (ABL) is defined in the NPI as a single figure background level for each assessment period (day, evening and night). It is the tenth percentile of the measured L90 statistical noise levels.
Ambient Noise	The noise associated with a given environment. Typically, a composite of sounds from many sources located both near and far where no particular sound is dominant.
A Weighting	A standard weighting of the audible frequencies designed to reflect the response of the human ear to noise.
dBA	Noise is measured in units called decibels (dB). There are several scales for describing noise, the most common being the 'A-weighted' scale. This attempts to closely approximate the frequency response of the human ear.
dB(Z), dB(L)	Decibels Linear or decibels Z-weighted.
Hertz (Hz)	The measure of frequency of sound wave oscillations per second - 1 oscillation per second equals 1 hertz.
LA10	A noise level which is exceeded 10 % of the time. It is approximately equivalent to the average of maximum noise levels.
LA90	Commonly referred to as the background noise, this is the level exceeded 90 % of the time.
LAeq	The summation of noise over a selected period of time. It is the energy average noise from a source, and is the equivalent continuous sound pressure level over a given period.
LAm _{ax}	The maximum root mean squared (rms) sound pressure level received at the microphone during a measuring interval.
RBL	The Rating Background Level (RBL) is an overall single figure background level representing each assessment period over the whole monitoring period. The RBL is used to determine the intrusiveness criteria for noise assessment purposes and is the median of the ABL's.
Sound power level (LW)	This is a measure of the total power radiated by a source. The sound power of a source is a fundamental location of the source and is independent of the surrounding environment. Or a measure of the energy emitted from a source as sound and is given by : $= 10 \cdot \log_{10} (W/W_0)$ Where: W is the sound power in watts and W ₀ is the sound reference power at 10-12 watts.

Table A2 provides a list of common noise sources and their typical sound level.

Table A2 Common Noise Sources and Their Typical Sound Pressure Levels (SPL), dBA

Source	Typical Sound Level
Threshold of pain	140
Jet engine	130
Hydraulic hammer	120
Chainsaw	110
Industrial workshop	100
Lawn-mower (operator position)	90
Heavy traffic (footpath)	80
Elevated speech	70
Typical conversation	60
Ambient suburban environment	40
Ambient rural environment	30
Bedroom (night with windows closed)	20
Threshold of hearing	0

Figure A1 – Human Perception of Sound

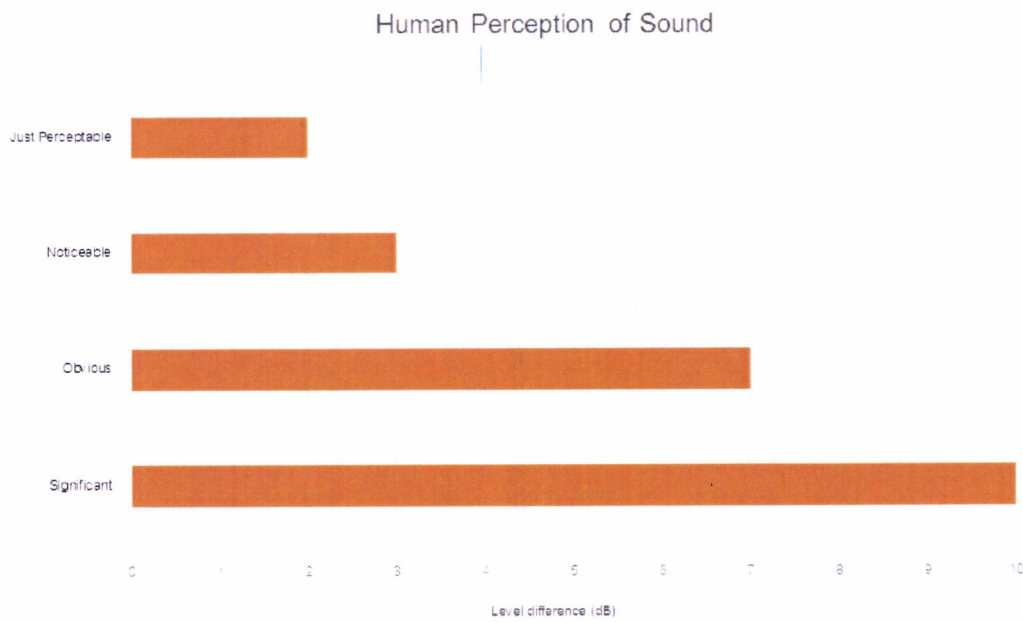

Muller Acoustic Consulting Pty Ltd
PO Box 262, Newcastle NSW 2300
ABN: 36 602 225 132
P: +61 2 4920 1833
www.mulleracoustic.com

